


NOTE: IF THE RETURN CANNOT BE BY GRAVITY, PROVIDE THE RETURN WITH THE HELP OF A PUMP OR INSTALL A SAFETY DRAIN, REFERENCE DRAWINGS M.T.-04,13,14,16

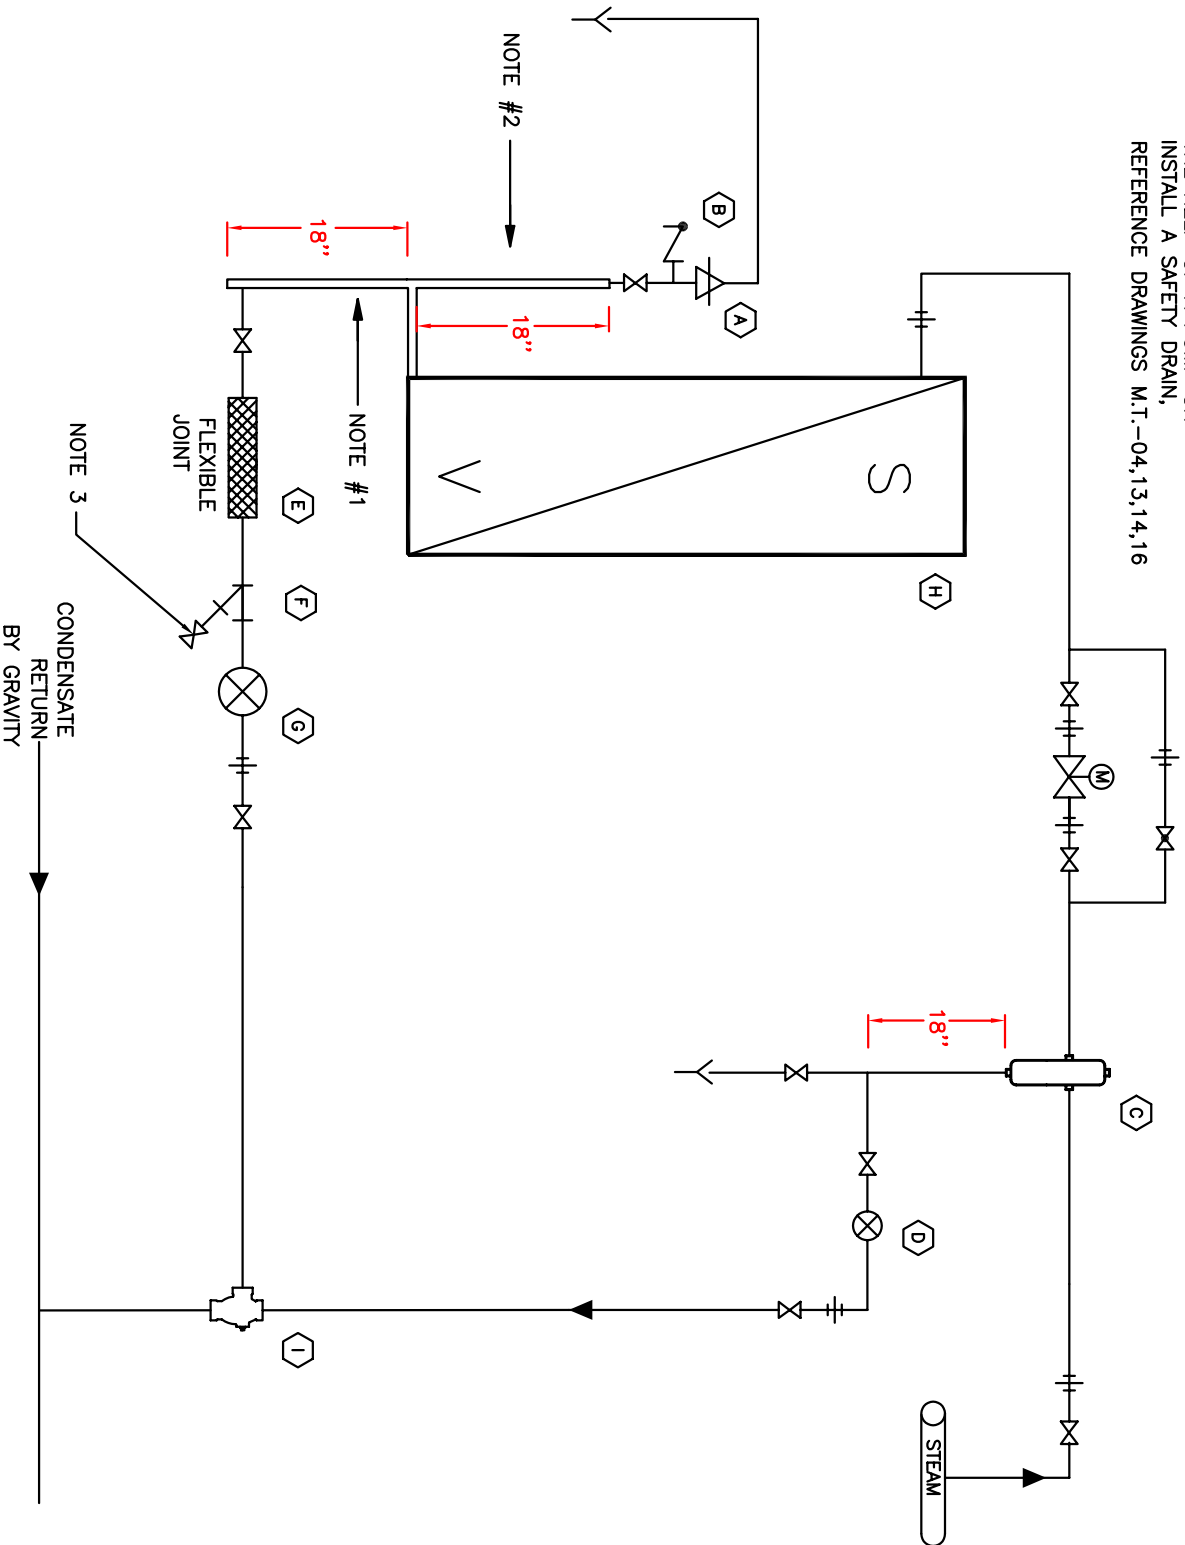

ITEMS

- A AUTOMATIC AIR VENT
- B VACUUM BREAKER
- C SEPARATOR
- D STEAM TRAP WITH STRAINER
- E FLEXIBLE JOINT
- F STRAINER WITH VALVE
- G MAIN STEAM TRAP
- H VERTICAL COIL
- I MIXER (SEE DRAWING M.T.-29-A)

NOTE:  
 1. SAME DIAMETER AS THE OUTLET OF THE EQUIPMENT  
 2. SAME DIAMETER AS THE OUTLET OF THE EQUIPMENT AND NON INSULATED

CUSTOMER:

PROJECT:


TITLE:

COIL VERTICAL TUBES

DWG.NO.: M.T.-03-A

REV.NO.:

DATE: 06-12-2004



**MAXI THERM**

maxi-therm.net