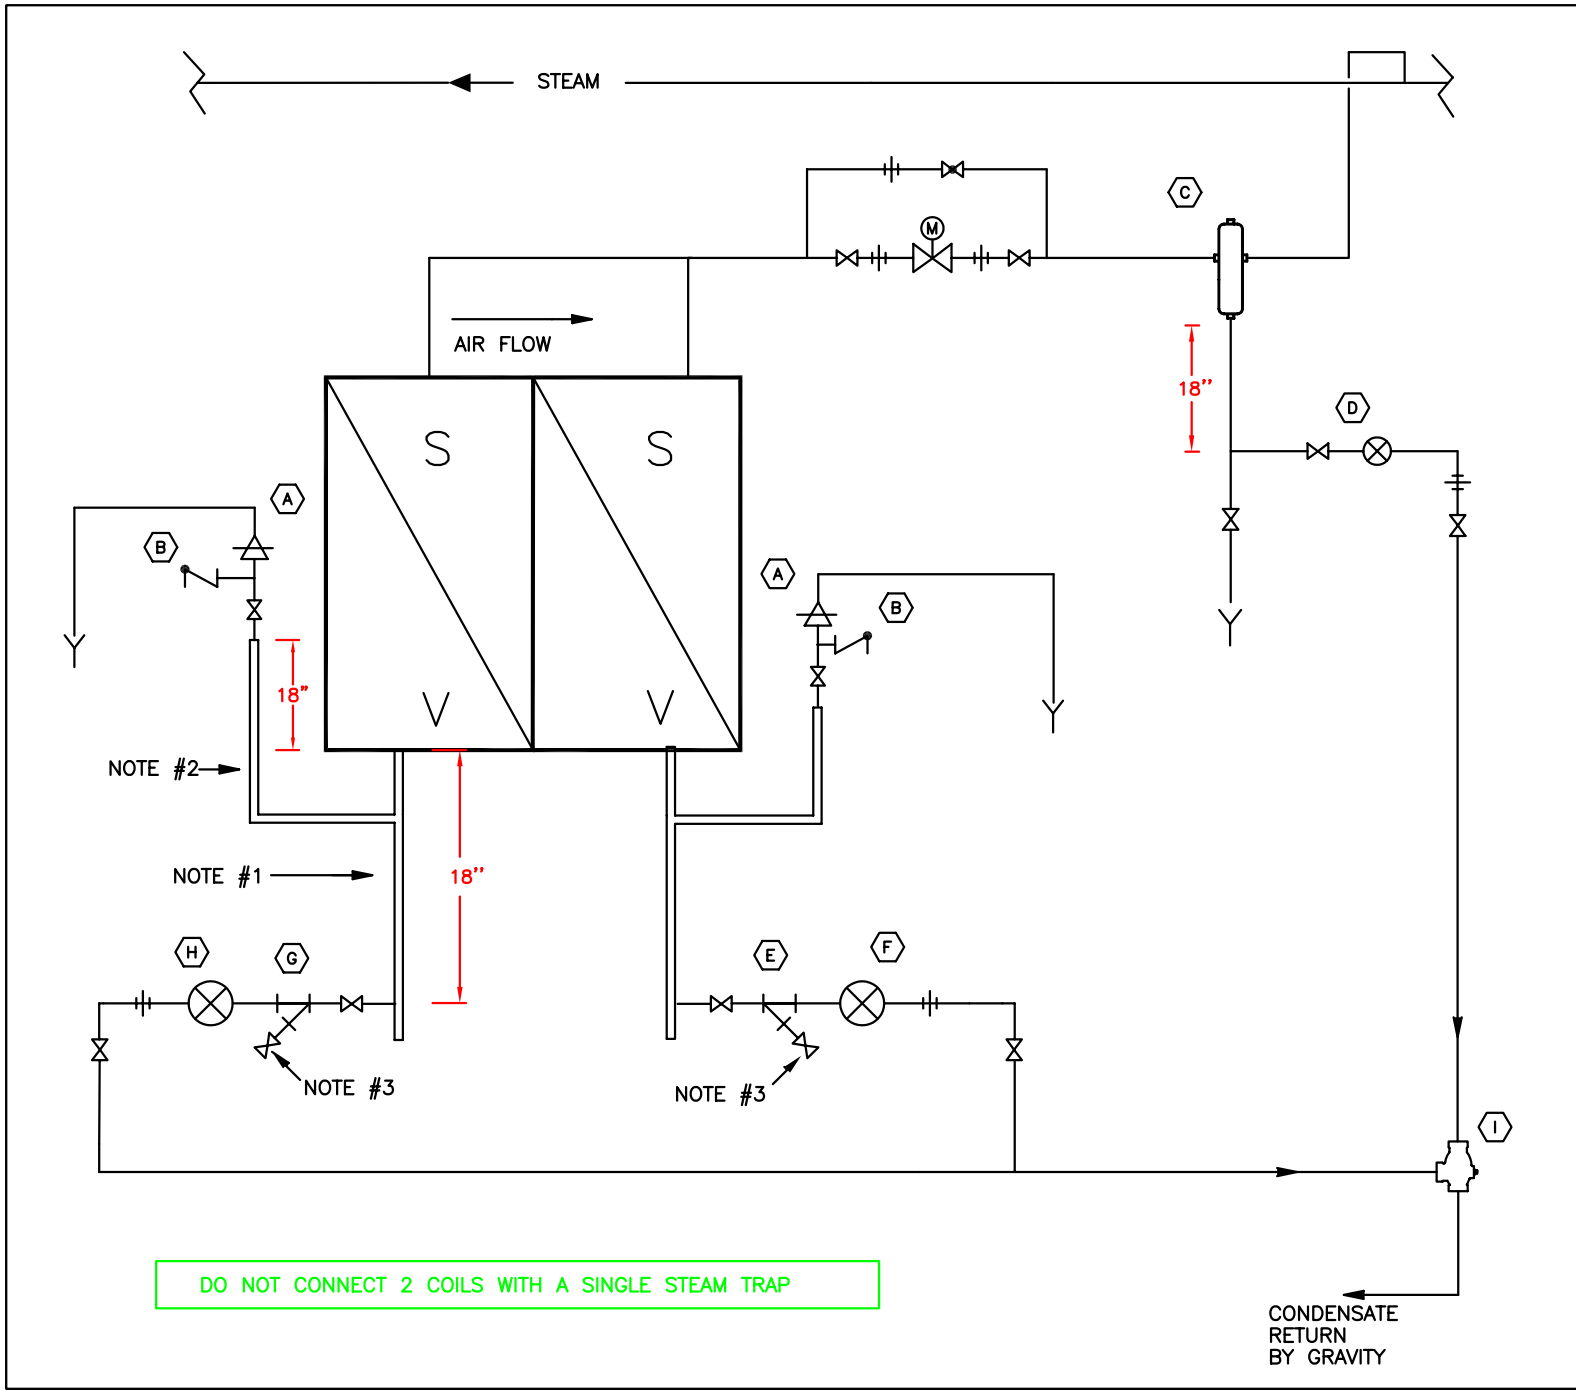

DO NOT CONNECT 2 COILS WITH A SINGLE STEAM TRAP

ITEMS

A	AUTOMATIC AIR VENT
B	VACUUM BREAKER
C	SEPARATOR
D	STEAM TRAP WITH STRAINER
E	STRAINER WITH VALVE
F	MAIN STEAM TRAP
G	STRINER WITH VALVE
H	MAIN STEAM TRAP
I	MIXER (SEE DRAWING M.T.–29–A)

IF THE RETURN CANNOT BE BY GRAVITY, PROVIDE THE RETURN WITH THE HELP OF A PUMP OR INSTALL A SAFETY DRAIN. REFERENCE DRAWING M.T.–04,13,14&16

NOTE:
1. SAME DIAMETER AS THE OUTLET OF THE EQUIPMENT
2. SAME DIAMETER AS THE OUTLET OF THE EQUIPMENT AND NON INSULATED
3. DRAIN DURING SHUT DOWN

CUSTOMER:

PROJECT:

TITLE: COILS IN SERIES

DWG.NO.: M.T.–07–A

REV.NO.:

DATE: 06–12–2004

MAXI THERM
maxi-therm.net