


ITEMS

- (A) AUTOMATIC AIR VENT
- (B) CHECK VALVE
- (C) SEPARATOR
- (D) STEAM TRAP
- (E) FLASH TANK
- (F) MAIN STEAM TRAP
- (G) PRESSURE REDUCING STATION
- (H) MIXER (SEE DRAWING M.T.-29-A)
- (I) STRAINER

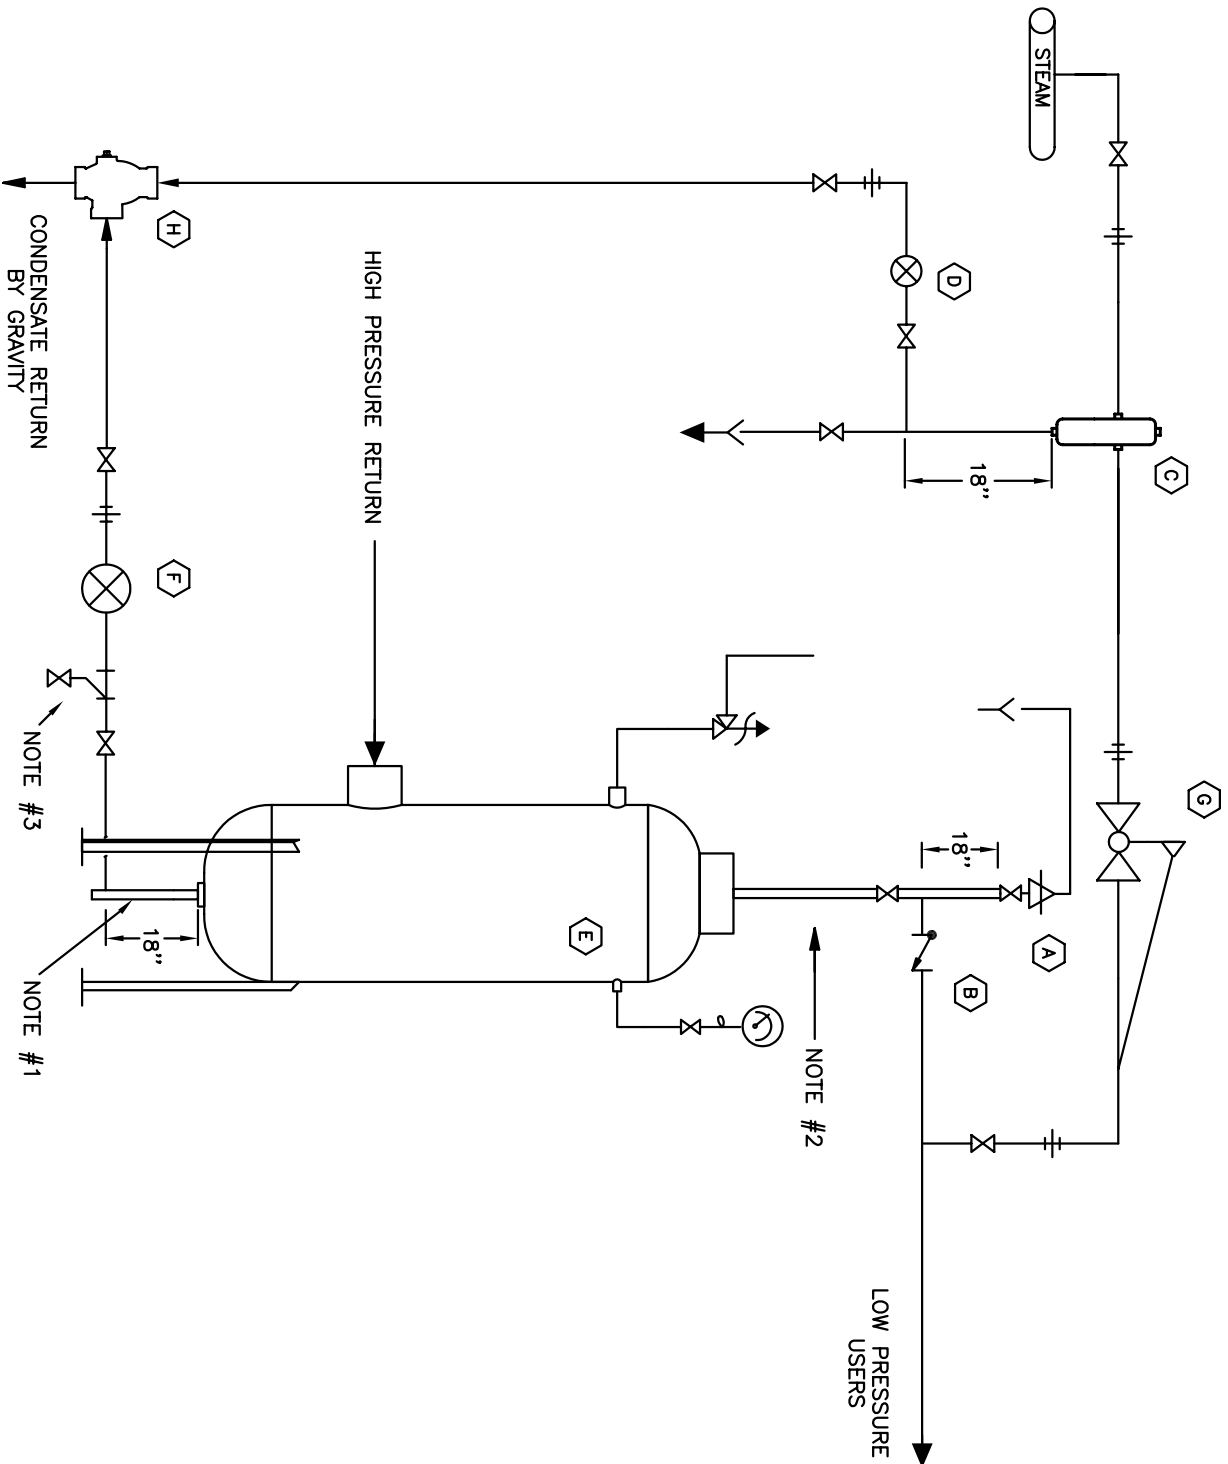

NOTE: 1. SAME DIAMETER AS THE OUTLET OF THE EQUIPMENT
 2. SAME DIAMETER AS THE OUTLET OF THE EQUIPMENT AND NON INSULATED
 3. DRAIN DURING SHUT DOWN

CUSTOMER:
 PROJECT:

TITLE:
 FLASH TANK WITH
 LOW PRESSURE USERS

DWG. NO.:	M.T.-19A-A	REV. NO.:	
DATE:	08-12-2004		

